

# KaControl Panel SEL4.0

## - Activating BACnet licenses -

### Instructions for Installing a BACnet License on the KaControl Panel SEL4.0

This guide explains the process of activating a BACnet license on the KaControl Panel SEL4.0. There are two different BACnet licenses available for selection:

- BACnet Advanced Application Controller (B-AAC) - acts as a server and is connected to BACnet Global Application (GA).
- BACnet Building Controller (B-BC) - acts as a server/client and can communicate with other BACnet server devices as well as BACnet GA.

Both licenses can be activated by uploading a specific plugin file (.ap1) to the controller

The available license types are:

- 196003270401 - BACnet B-AAC Client License (Type 3270401)
- 196003270402 - BACnet B-BC Client/Server License (Type 3270402)


To activate one of the two licenses on the KaControl Tableau SEL4.0 Type3232223, please follow these steps:

1. To transfer the .ap1 file to the controller, you have three options:
  - A) Via FTP Upload: Upload the .ap1 file to the controller using the FTP protocol.
  - B) Via direct USB connection between PC and c.pco: Connect your PC directly to the c.pco module of the controller and copy the .ap1 file this way.
  - C) Via USB stick: Alternatively, you can copy the .ap1 file to a USB stick and then connect it to the controller.


Please make sure that the word "UPGRADE" is written in capital letters to successfully complete the process.



2. Afterward, the upgrade process can be initiated via the PGD.

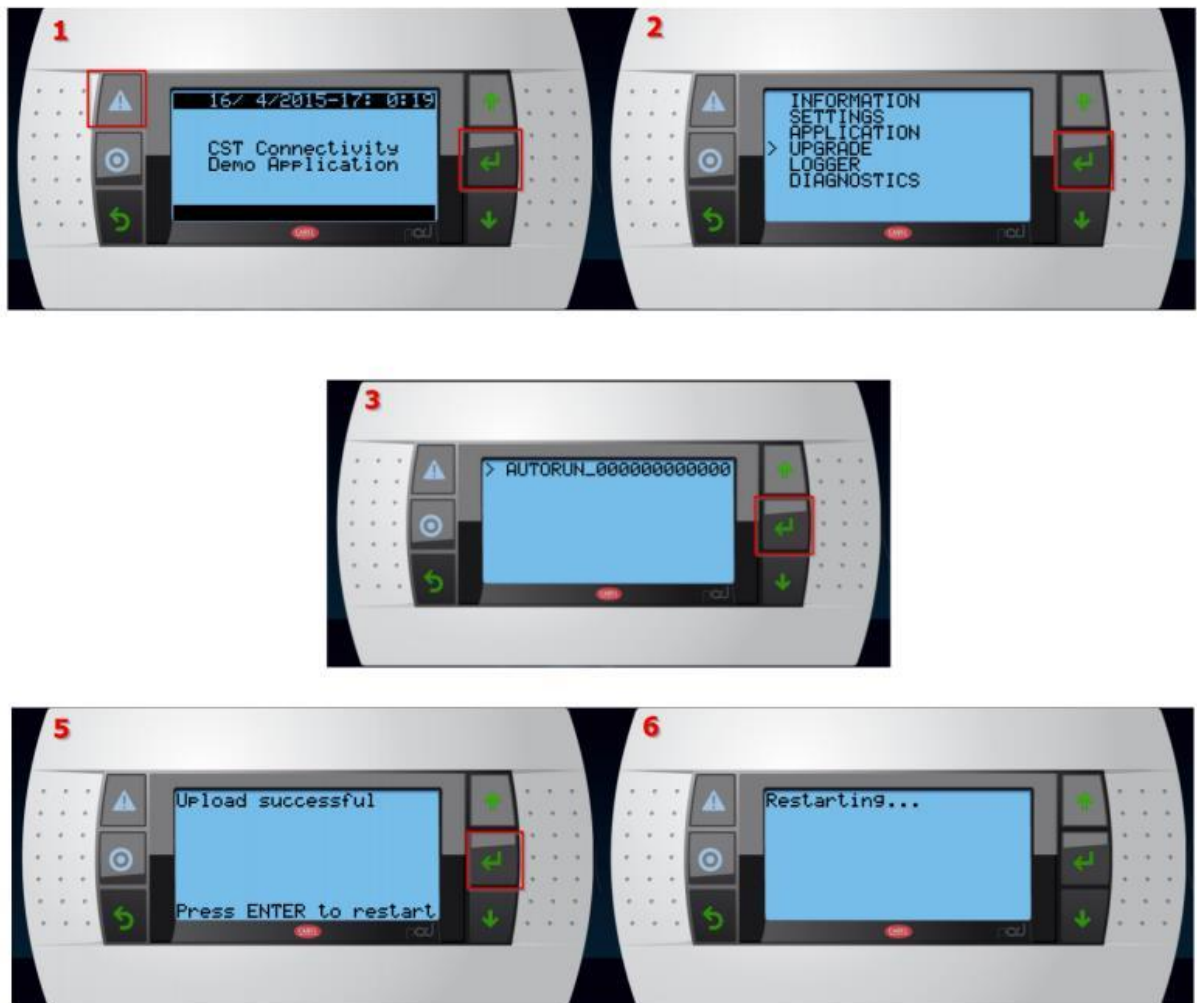

3. Now you can check in the INFORMATION > INFO section whether the license is set up correctly.

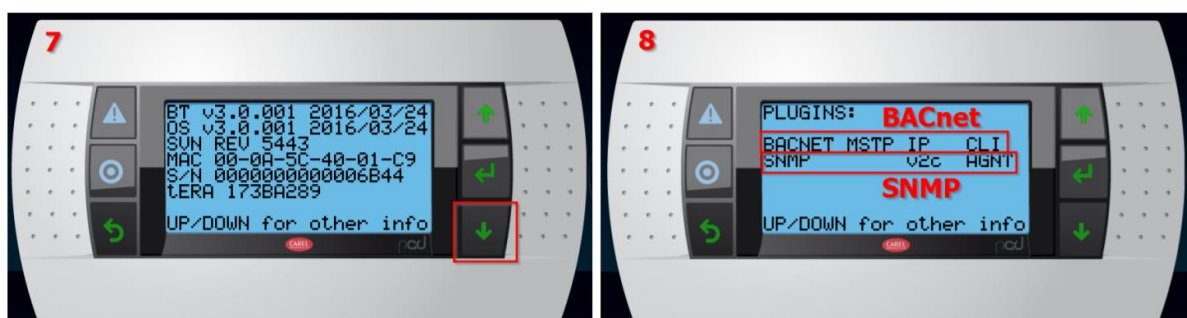

Document Version: 1.0

Document Date: 2023-08-01

Creator: A. Schomaker